



SINGLE STORY CONVENTIONAL WOOD-FRAME CONSTRUCTION SHEET

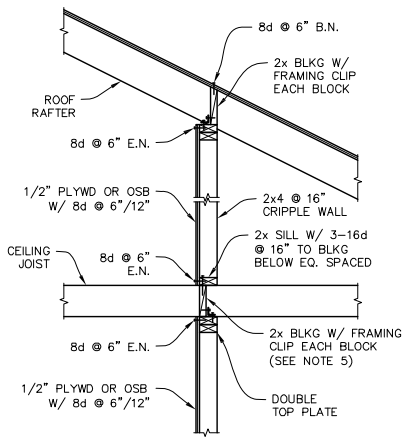


INTERIOR BRACED WALL

1

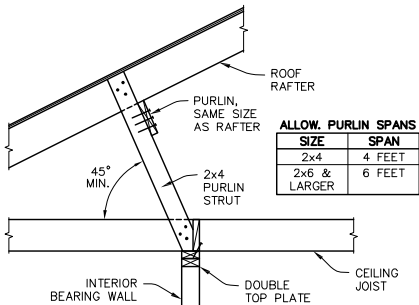

PURLIN BRACING

2

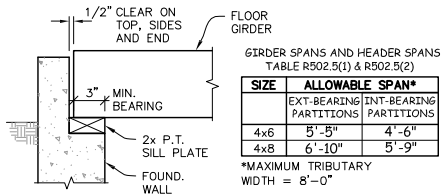


NOTES:


- (1) FLOOR GIRDERS SHALL BE SPACED AT 8'-0" O.C. MAX.
- (2) SILL PLATE SHALL BE PRESERVATIVE-TREATED WHEN LESS THAN 8" FROM SOIL.

FLOOR GIRDERS

3



FRAMING CLIP AT RAFTER

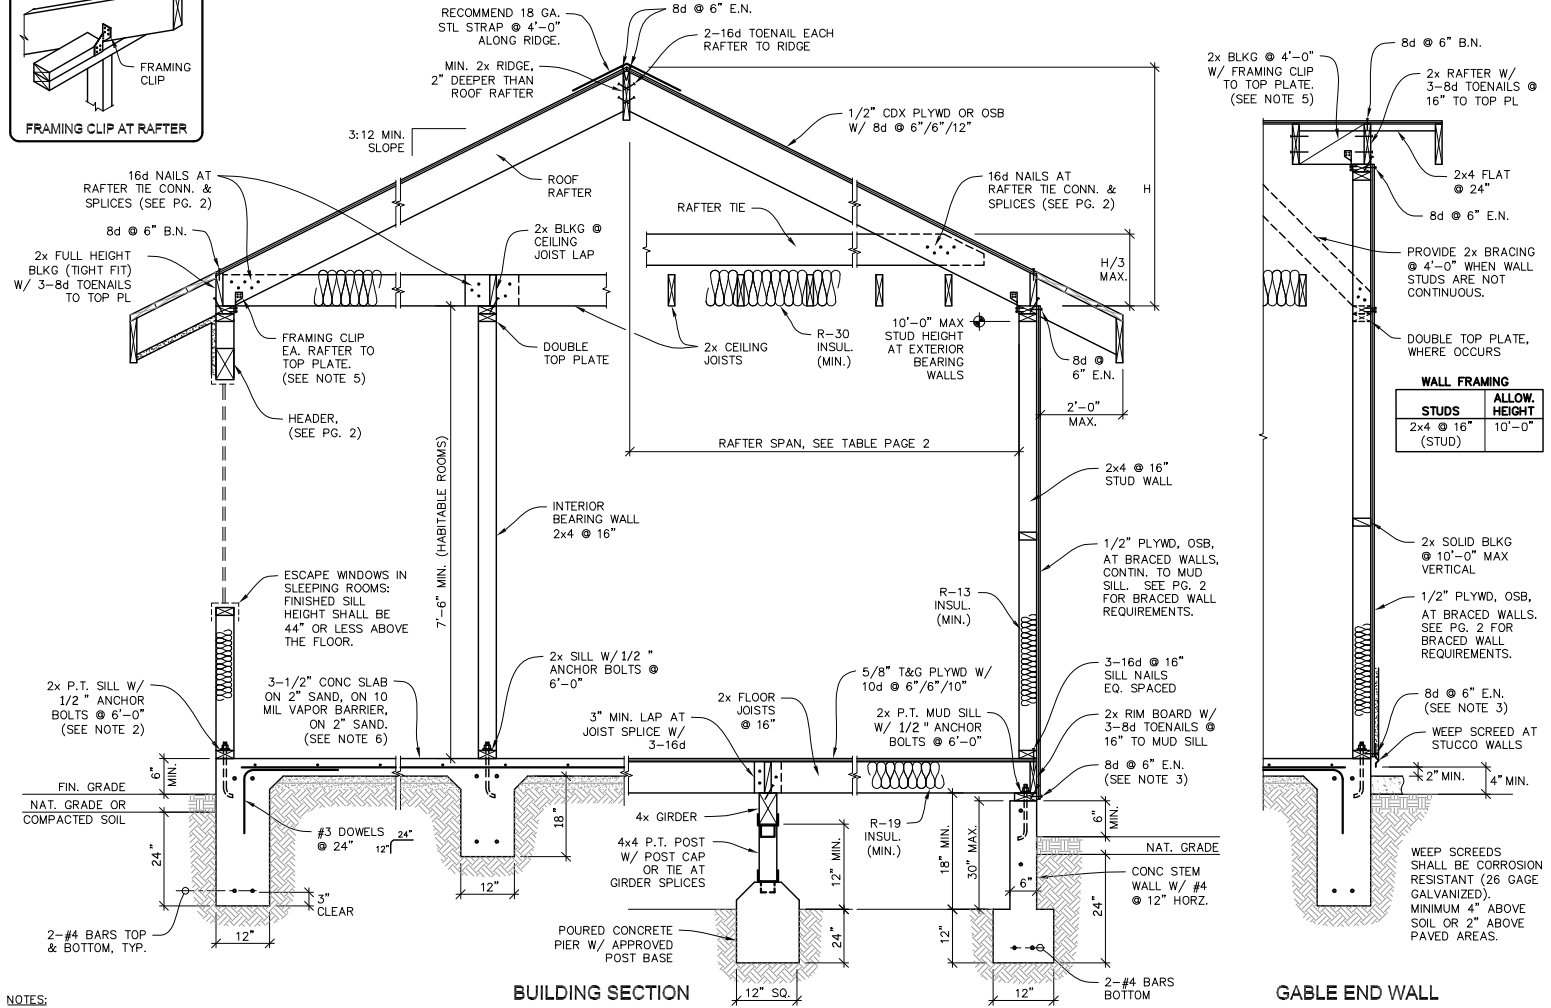

BUILDING SECTION

GABLE END WALL

NOTES:

- (1) MINIMUM CONCRETE STRENGTH: 2500 psi
- (2) ANCHOR BOLTS SHALL BE EMBEDDED AT LEAST 7" INTO CONCRETE. FOR TWO-POUR FOUNDATIONS, THE REQUIRED EMBEDMENT SHALL BE PROVIDED IN THE FIRST POUR. ANCHOR BOLTS SHALL BE LOCATED NOT MORE THAN 12", OR LESS THAN 4-1/2" FROM SILL PLATE ENDS, CORNERS, AND SPLICES. ANCHOR BOLTS SHALL BE INSTALLED WITH 1/4" x 3" SQUARE PLATE WASHERS.
- (3) FASTENERS FOR PRESERVATIVE TREATED WOOD SHALL BE OF HOT DIPPED ZINC-COATED GALVANIZED STEEL, STAINLESS STEEL, SILICON BRONZE OR COPPER.
- (4) FOUNDATIONS SHOWN ABOVE ASSUME EXPANSIVE SOILS ARE PRESENT AT THE SITE. FOUNDATION REQUIREMENTS MAY BE REDUCED WHEN JUSTIFIED BY A GEOTECHNICAL REPORT OR APPROVED BY THE BUILDING OFFICIAL.
- (5) FRAMING CLIPS SHALL BE 18 GAGE STEEL WITH FOUR 8d NAILS PER LEG (EIGHT 8d NAILS PER CLIP). FRAMING CLIPS SHALL BE ICC APPROVED AND INSTALLED PER MANUFACTURER'S RECOMMENDATIONS.
- (6) SLAB ON GRADE SHALL BE REINFORCED WITH #3 BARS @ 18" EACH WAY. REINFORCING SHALL BE LOCATED AT SLAB MID-HEIGHT.

WALL FRAMING

STUDS	ALLOW. HEIGHT
2x4 @ 16" (STUD)	10'-0"

2x SOLID BLKG @ 10'-0" MAX VERTICAL

1/2" PLYWD, OSB, AT BRACED WALLS. SEE PG. 2 FOR BRACED WALL REQUIREMENTS.

WEEP SCREENS SHALL BE CORROSION RESISTANT (26 GAGE GALVANIZED), MINIMUM 4" ABOVE SOIL OR 2" ABOVE PAVED AREAS.

THIS SHEET IS A SUMMARY OF THE PROVISIONS OF THE 2013 CRC FOR USE WITH SINGLE-STORY CONSTRUCTION ONLY. DEAD LOAD SHALL NOT EXCEED 15 PSF FOR AVERAGE ROOF AND CEILING, OR EXTERIOR WALLS OR FLOORS AND PARTITIONS. FLOOR LIVE LOAD SHALL NOT EXCEED 40 PSF. THIS SHEET IS FOR REFERENCE ONLY AND IS NOT A SUBSTITUTE FOR ACCURATE DRAWINGS PREPARED FOR EACH PROPOSED CONSTRUCTION PROJECT.



TYPE V SHEET/ LIGHT FRAME CONSTRUCTION




HELP FOR THE HOMEOWNER

Carpinteria Building & Safety

Dan Chepley / CBO
 Chief Building Inspector / Plans Examiner
 Date: 09/19/2017

09/19/2017
 Date: Sheet 1 of 2
 B800

SINGLE STORY CONVENTIONAL WOOD-FRAME CONSTRUCTION SHEET

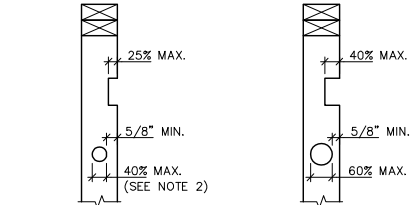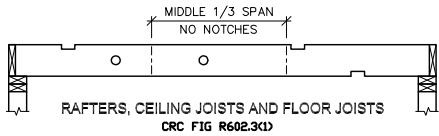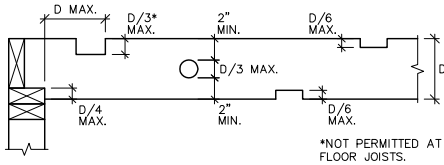


BEARING PARTITIONS & ALL EXTERIOR WALLS
CRC FIG R602.6(1) & R602.6(2)

NON-BEARING PARTITIONS
CRC FIG R602.6(1) & R602.6(2)

NOTES:

- BORED HOLES SHALL NOT BE LOCATED AT THE SAME SECTION AS A CUT OR NOTCH.
- BORED HOLES IN BEARING STUDS MAY BE INCREASED TO 60% IF STUDS ARE DOUBLED; NO MORE THAN TWO SUCCESSIVE DOUBLED STUDS MAY BE BORED.

NOTCHING AND HOLES

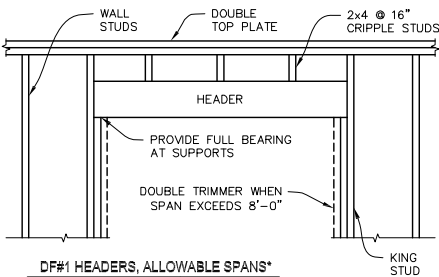

DF#1 HEADERS, ALLOWABLE SPANS*

SPAN	SIZE
UP TO 3'-6"	4x4
3'-7" TO 5'-5"	4x6
5'-6" TO 6'-10"	4x8
6'-11" TO 8'-5"	4x10
8'-6" TO 9'-9"	4x12

CRC TABLE R502.5(1)

HEADER/LINTEL

GENERAL NOTES:

- SEE FASTENING SCHEDULE (TABLE R602.3(1)) FOR NAILING NOT SHOWN.
- BEARING WALLS AND BRACED WALLS REQUIRE CONTINUOUS FOOTINGS.
- "DF" ON THESE SHEETS REFERS TO DOUGLAS FIR-LARCH. SAWN LUMBER SHALL BE IDENTIFIED BY THE GRADE MARK OF AN APPROVED LUMBER GRADING OR INSPECTION AGENCY.
- "DL" AND "LL" ON THESE SHEETS INDICATES "DEAD LOAD" AND "LIVE LOAD," RESPECTIVELY.
- WOOD MEMBERS SHALL BE OF SUFFICIENT SIZE TO PREVENT SPLITTING DUE TO NAILING. SPLIT MEMBERS SHALL BE REMOVED AND REPLACED.
- "P.T." ON THESE SHEETS INDICATES PRESERVATIVE-TREATED WOOD.
- WHEN FRAMED WITH ENGINEERED WOOD TRUSSES, ROOF DIAPHRAGMS SHALL BE CONNECTED TO INTERIOR BRACED WALLS BY MEANS OF DRAG TRUSSES OR TRUSS BLOCKING.

DF#2 RAFTERS, ALLOWABLE SPANS*

RAFTER SPACING	DL=10 PSF, LL=20 PSF			
	2x4	2x6	2x8	2x10
12"	10'-10"	16'-7"	21'-0"	25'-8"
16"	9'-10"	14'-4"	18'-2"	22'-3"
24"	8'-0"	11'-9"	14'-10"	18'-2"

* DATA TAKEN FROM TABLE R802.5.1(1)

DF#2 CEILING JOISTS, ALLOWABLE SPANS*

JOIST SPACING	ATTICS WITHOUT STORAGE, LL=10 PSF				ATTICS WITH LIMITED STORAGE, LL=20 PSF			
	2x4	2x6	2x8	2x10	2x4	2x6	2x8	2x10
12"	12'-5"	19'-6"	25'-8"	-	9'-10"	14'-10"	18'-9"	22'-11"
16"	11'-3"	17'-8"	23'-0"	-	8'-9"	12'-10"	16'-3"	19'-10"
24"	9'-10"	14'-10"	18'-9"	22'-11"	7'-2"	10'-6"	13'-3"	16'-3"

*DATA FROM CRC TABLE R802.4(2) ATTICS WITH STORAGE ARE THOSE WHERE THE CLEAR HEIGHT BETWEEN THE CEILING JOIST AND RAFTER IS 42" OR GREATER. ATTICS SHALL BE UNINHABITABLE. CEILING DEAD LOAD SHALL NOT EXCEED 5 PSF.

RAFTER TIE CONNECTIONS, # 16d COMMON NAILS, SEE NOTE (5)*

TIE SPACING	ROOF PITCH													
	3:12		4:12		5:12		7:12		9:12		12:12			
	SPAN	SPAN	SPAN	SPAN	SPAN	SPAN	SPAN	SPAN	SPAN	SPAN	SPAN			
12"	4	6	8	3	5	6	3	4	5	3	4	3	3	3
16"	5	8	10	4	6	8	3	5	6	3	4	5	3	4
24"	7	11	15	5	8	12	4	7	9	3	5	7	3	4

*CRC TABLE R802.5.1(9) VALUES ADJUSTED FOR DF#2 FRAMING. THE NUMBER OF NAILS SPECIFIED IN THE TABLE SHALL BE PROVIDED AT EACH CONNECTION. WHEN FULL-HEIGHT INTERIOR BEARING WALLS OR PURLIN BRACING ARE PROVIDED, RAFTER TIE NAILING MAY BE REDUCED PROPORTIONAL TO THE REDUCTION IN RAFTER SPAN; NO LESS THAN 3 NAILS SHALL BE PROVIDED AT EACH CONNECTION. NO SNOW LOAD.

DF#2 FLOOR JOISTS, ALLOWABLE SPANS*


JOIST SPACING	DL=10 PSF, LL=40 PSF		
	2x6	2x8	2x10
12"	10'-9"	14'-2"	17'-9"
16"	9'-9"	12'-7"	15'-5"
24"	8'-1"	10'-3"	12'-7"

* DATA FROM CRC TABLE R502.3.1(2)



PLYWOOD OR OSB FLOOR AND ROOF SHEATHING, ALLOWABLE SPANS*

SPAN RATING FLOOR/ROOF	SHEATHING GRADES	ROOF				FLOOR
		MAX. SPAN (in.)		LOADS (psf.)		
		WITH EDGE SUPPORT	WITHOUT EDGE SUPPORT	TOTAL LOAD	LIVE LOAD	
24/0	3/8	24	20	40	30	0
24/16	7/16	24	24	50	40	16
32/16	15/32, 1/2	32	28	40	30	16
40/20	19/32, 5/8	40	32	40	30	20
48/24	23/32, 3/4	48	36	45	35	24

*DATA FROM CRC TABLE R503.2.1(1) SHEATHING PANELS SHALL BE CONTINUOUS OVER TWO OR MORE SPANS AND PERPENDICULAR TO SUPPORTS. FOR 1/2" SHEATHING, MAXIMUM SPAN SHALL BE 24". EDGE SUPPORT MAY BE PROVIDED BY TONGUE AND GROOVE EDGES, 2X BLOCKING, OR PANEL EDGE CLIPS.

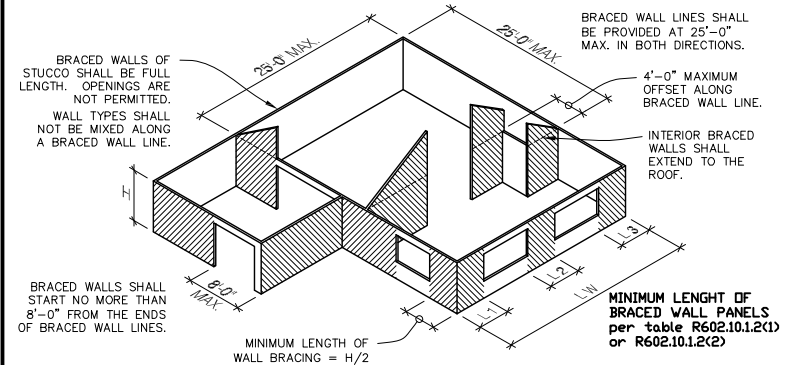

BASIC COMPONENTS OF THE LATERAL BRACING SYSTEM

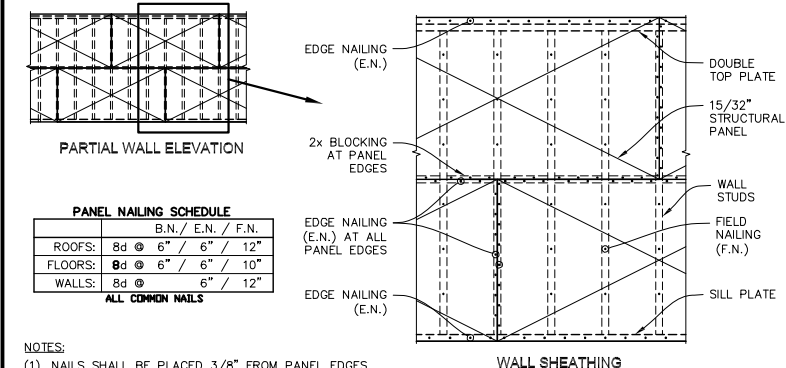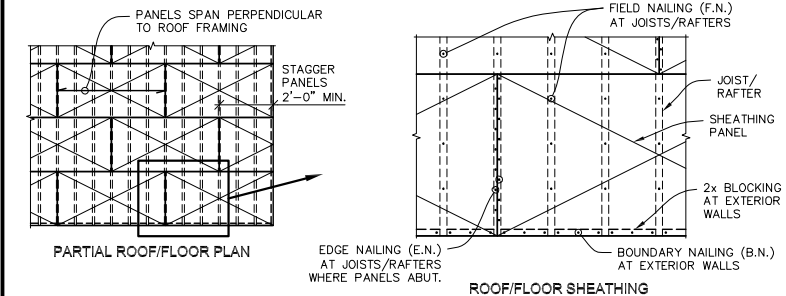

NOTES:

- NAILS SHALL BE PLACED 3/8" FROM PANEL EDGES.
- PROVIDE 1/8" GAP BETWEEN SHEATHING PANELS.
- MINIMUM DIMENSION OF SHEATHING PANEL IN ANY DIRECTION SHALL BE 2'-0"
- WALL SHEATHING PANELS MAY BE INSTALLED WITH THE LONG DIRECTION ORIENTED VERTICALLY.